


STEEL FRAME CONSTRUCTION MUST BE SPECIFIC DESIGN MEETING REQUIREMENTS OF NZBC.
 FOR STEEL FRAMED BUILDINGS SITUATED IN NZS 3604 WIND ZONES UP TO VERY HIGH STUDS ARE AT 600mm MAX.CTRS. FOR ALL OTHER DWELLINGS STUDS ARE AT 400mm MAX.CTRS, DWANGS ARE REQUIRED AT 800mm CTRS
 PROVIDE THERMAL BREAK TO ALL STEEL MEMBERS OR BRANZ APPRAISED PROPRIETARY RIGID AIR BARRIER/THERMAL BREAK

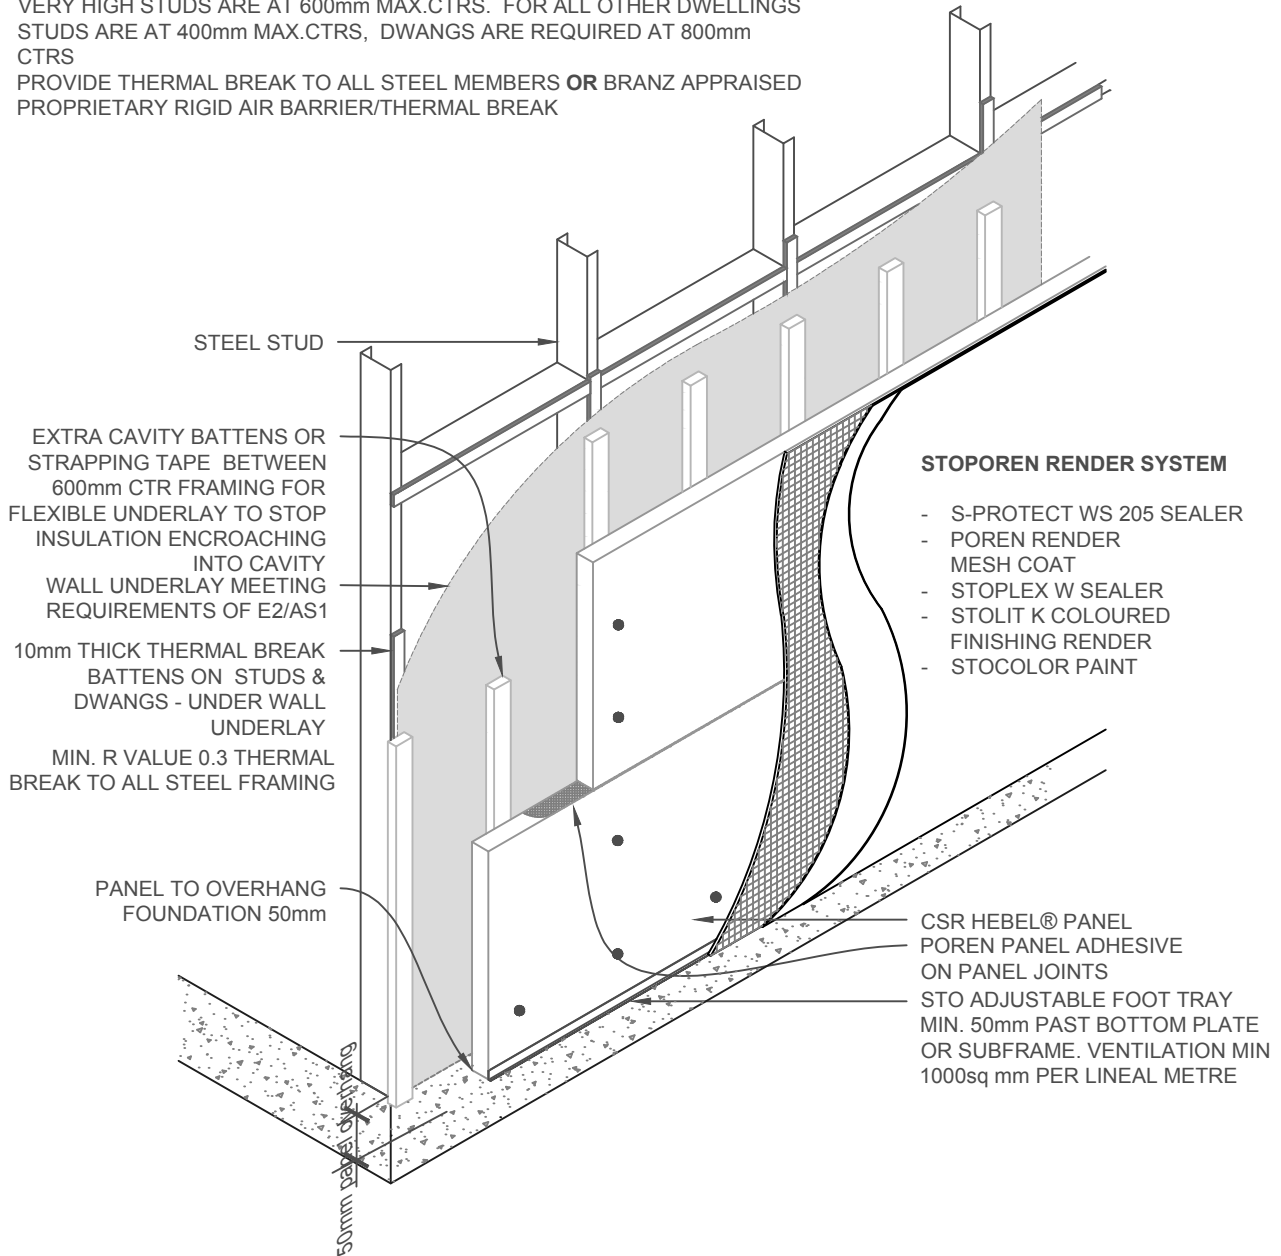

SCALE 1:20

STO POREN FACADE	STO POREN FACADE SYSTEM	PP 102
	CAVITY BATTEN SETOUT STEEL FRAME/THERMAL BREAK (600CTRS)	2017